


1

PROPOSED 8" STABILIZED SUBGRADE SHALL BE A MINIMUM OF 6% LIME BY WEIGHT OR 5% CEMENT BY WEIGHT AND COMPACTED TO 95% STANDARD PROCTOR DENSITY IN A RANGE OF 1% DRY TO 3% WET OF OPTIMUM MOISTURE CONTENT.

EXTEND STABILIZED SUBGRADE 2 FEET BEYOND EDGE OF PAVEMENT

8  
7/2

8" CONCRETE PAVEMENT  
NOT TO SCALE

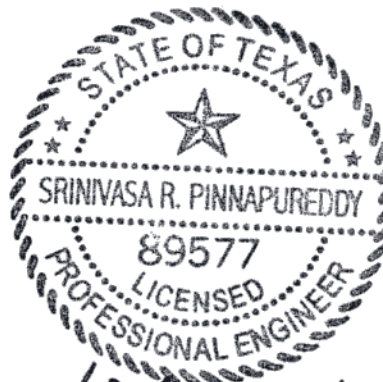

*S.R. Pinnapureddy 8/28/03*

1	08-14-03	ADDENDUM NO. 1
REVISION	DATE	DESCRIPTION
<b>NATIONAL AERONAUTICS &amp; SPACE ADMINISTRATION</b> <b>LYNDON B. JOHNSON SPACE CENTER HOUSTON, TEXAS</b>		
<b>ASTRONAUT QUARANTINE FACILITY BUILDING 27</b> <b>DETAILS</b>		
PROJECT NO. <b>02104</b>	SHEET NO. <b>C-27-02104</b>	
PROJECT ID <b>02104</b>		
CODE IDENT. NO. <b>2116</b>	SKT. NO. <b>C-27-007</b>	